


KEY PLAN

NOT TO SCALE

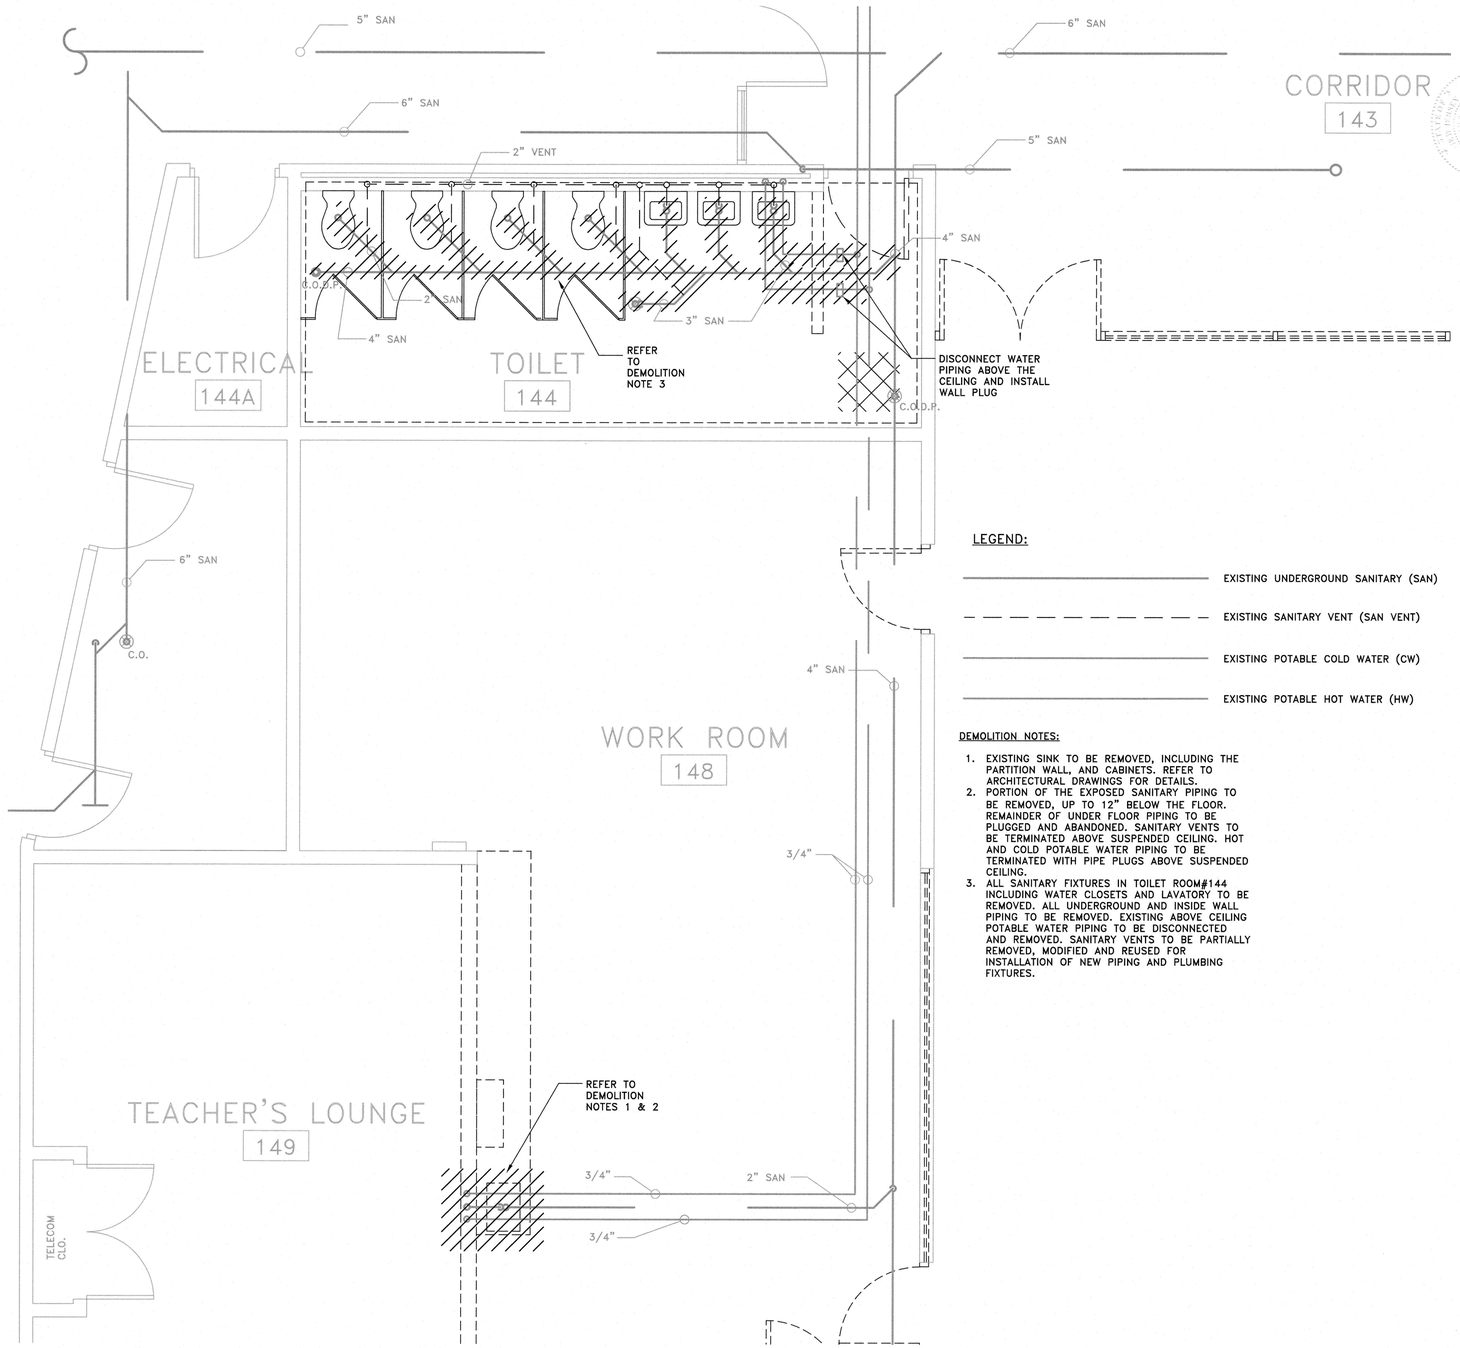

1 PLUMBING DEMOLITION PLAN

SCALE : 3/8"=1'0"

LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- EXISTING SANITARY VENT (SAN VENT)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)

DEMOLITION NOTES:

1. EXISTING SINK TO BE REMOVED, INCLUDING THE PARTITION WALL, AND CABINETS. REFER TO ARCHITECTURAL DRAWINGS FOR DETAILS.
2. PORTION OF THE EXPOSED SANITARY PIPING TO BE REMOVED, UP TO 12" BELOW THE FLOOR. REMAINDER OF UNDER FLOOR PIPING TO BE PLUGGED AND ABANDONED. SANITARY VENTS TO BE TERMINATED ABOVE SUSPENDED CEILING. HOT AND COLD POTABLE WATER PIPING TO BE TERMINATED WITH PIPE PLUGS ABOVE SUSPENDED CEILING.
3. ALL SANITARY FIXTURES IN TOILET ROOM#144 INCLUDING WATER CLOSETS AND LAVATORY TO BE REMOVED. ALL UNDERGROUND AND INSIDE WALL PIPING TO BE REMOVED. EXISTING ABOVE CEILING POTABLE WATER PIPING TO BE DISCONNECTED AND REMOVED. SANITARY VENTS TO BE PARTIALLY REMOVED, MODIFIED AND REUSED FOR INSTALLATION OF NEW PIPING AND PLUMBING FIXTURES.

ISSUED FOR BID-9/25/26

APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group

WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

CLIENT: WILLINGBORO TOWNSHIP

PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY

PROJECT NO.: M-0410-0011-000

CONTRACT NO.: BID#5-2026

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: MP
CHECKED BY:
DEPT. HEAD:

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


PLUMBING DEMOLITION PLAN
SENIOR CENTER (PARTIAL)

SCALE: AS NOTED

SHEET
PD1


FILE NO.:

Plotted: 9/22/2026 9:08 AM Last saved: 9/21/2026 4:03 PM File Names: M:\Projects\M0410001\1000\Drawings\CLG-PD1- PD2 Plumbing Demolition.dwg



KEY PLAN

NOT TO SCALE

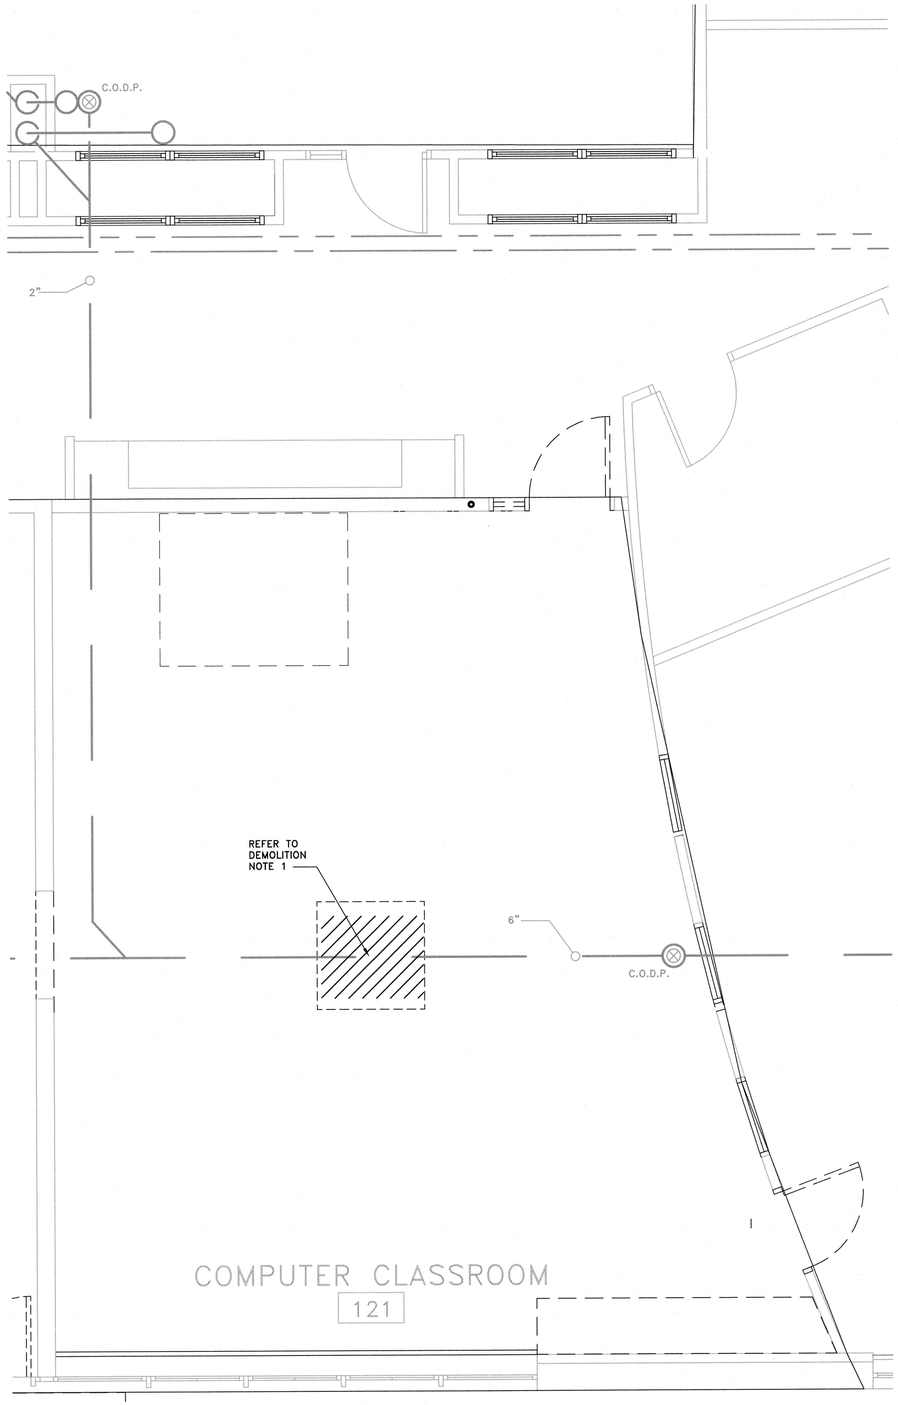

1 PLUMBING DEMOLITION PLAN

SCALE : 3/8"=1'0"

LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- EXISTING SANITARY VENT (SAN VENT)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)

DEMOLITION NOTES:

1. CONTRACTOR TO SAW CUT EXISTING SLAB AND EXCAVATE AS REQUIRED TO MAKE CONNECTION OF THE PROPOSED SANITARY PIPING INTO EXISTING SANITARY PIPING. THE INVERT OF THE EXISTING SANITARY IS ±9 FEET BELOW THE TOP OF THE FLOOR. CONTRACTOR TO FIELD VERIFY ALL EXISTING CONDITIONS. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR RESTORATION DETAILS.

ISSUED FOR BID-9/25/26

9.22.26
APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group

WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: MMP
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP

PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY

PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


PLUMBING DEMOLITION PLAN
SENIOR CENTER (PARTIAL)

SCALE: AS NOTED

SHEET
PD2


FILE NO.:

Plotted: 9/22/2026 3:18 PM Last saved: 9/22/2026 2:32 PM File Name: M:\Projects\M0410001100\Drawings\GLO-PD1 – PD2 Plumbing Demolition.dwg



KEY PLAN

NOT TO SCALE

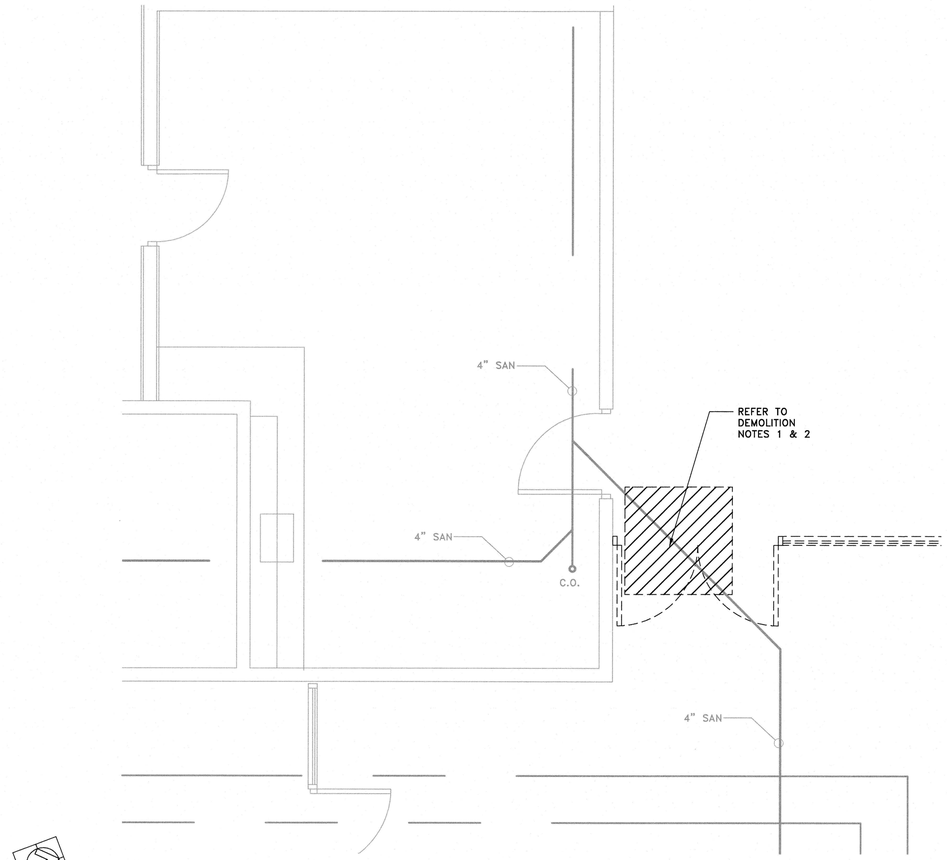

LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- EXISTING SANITARY VENT (SAN VENT)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)

DEMOLITION NOTES:

1. CONTRACTOR TO SAW CUT EXISTING SLAB AND EXCAVATE AS REQUIRED TO MAKE CONNECTION TO THE EXISTING SANITARY PIPING. THE INVERT OF THE EXISTING SANITARY IS ±6 FEET BELOW THE TOP OF THE FLOOR. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR RESTORATION DETAILS.
2. CONTRACTOR TO FIELD VERIFY ALL EXISTING CONDITIONS.

1 PLUMBING DEMOLITION PLAN

SCALE : 3/8"=1'0"

ISSUED FOR BID-9/25/26

Plotted: 9/22/2026 9:09 AM Last saved: 9/21/2026 4:03 PM File Name: M:\Projects\WO41000111000\Drawings\GLO-PD1- PD2 Plumbing Demolition.dwg

9.23.26
APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: MMP
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-3410-0011-000
CONTRACT NO.: BID#8-2026


KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER

PLUMBING DEMOLITION PLAN
SENIOR CENTER (PARTIAL)

SCALE: AS NOTED

SHEET
PD3

FILE NO.:

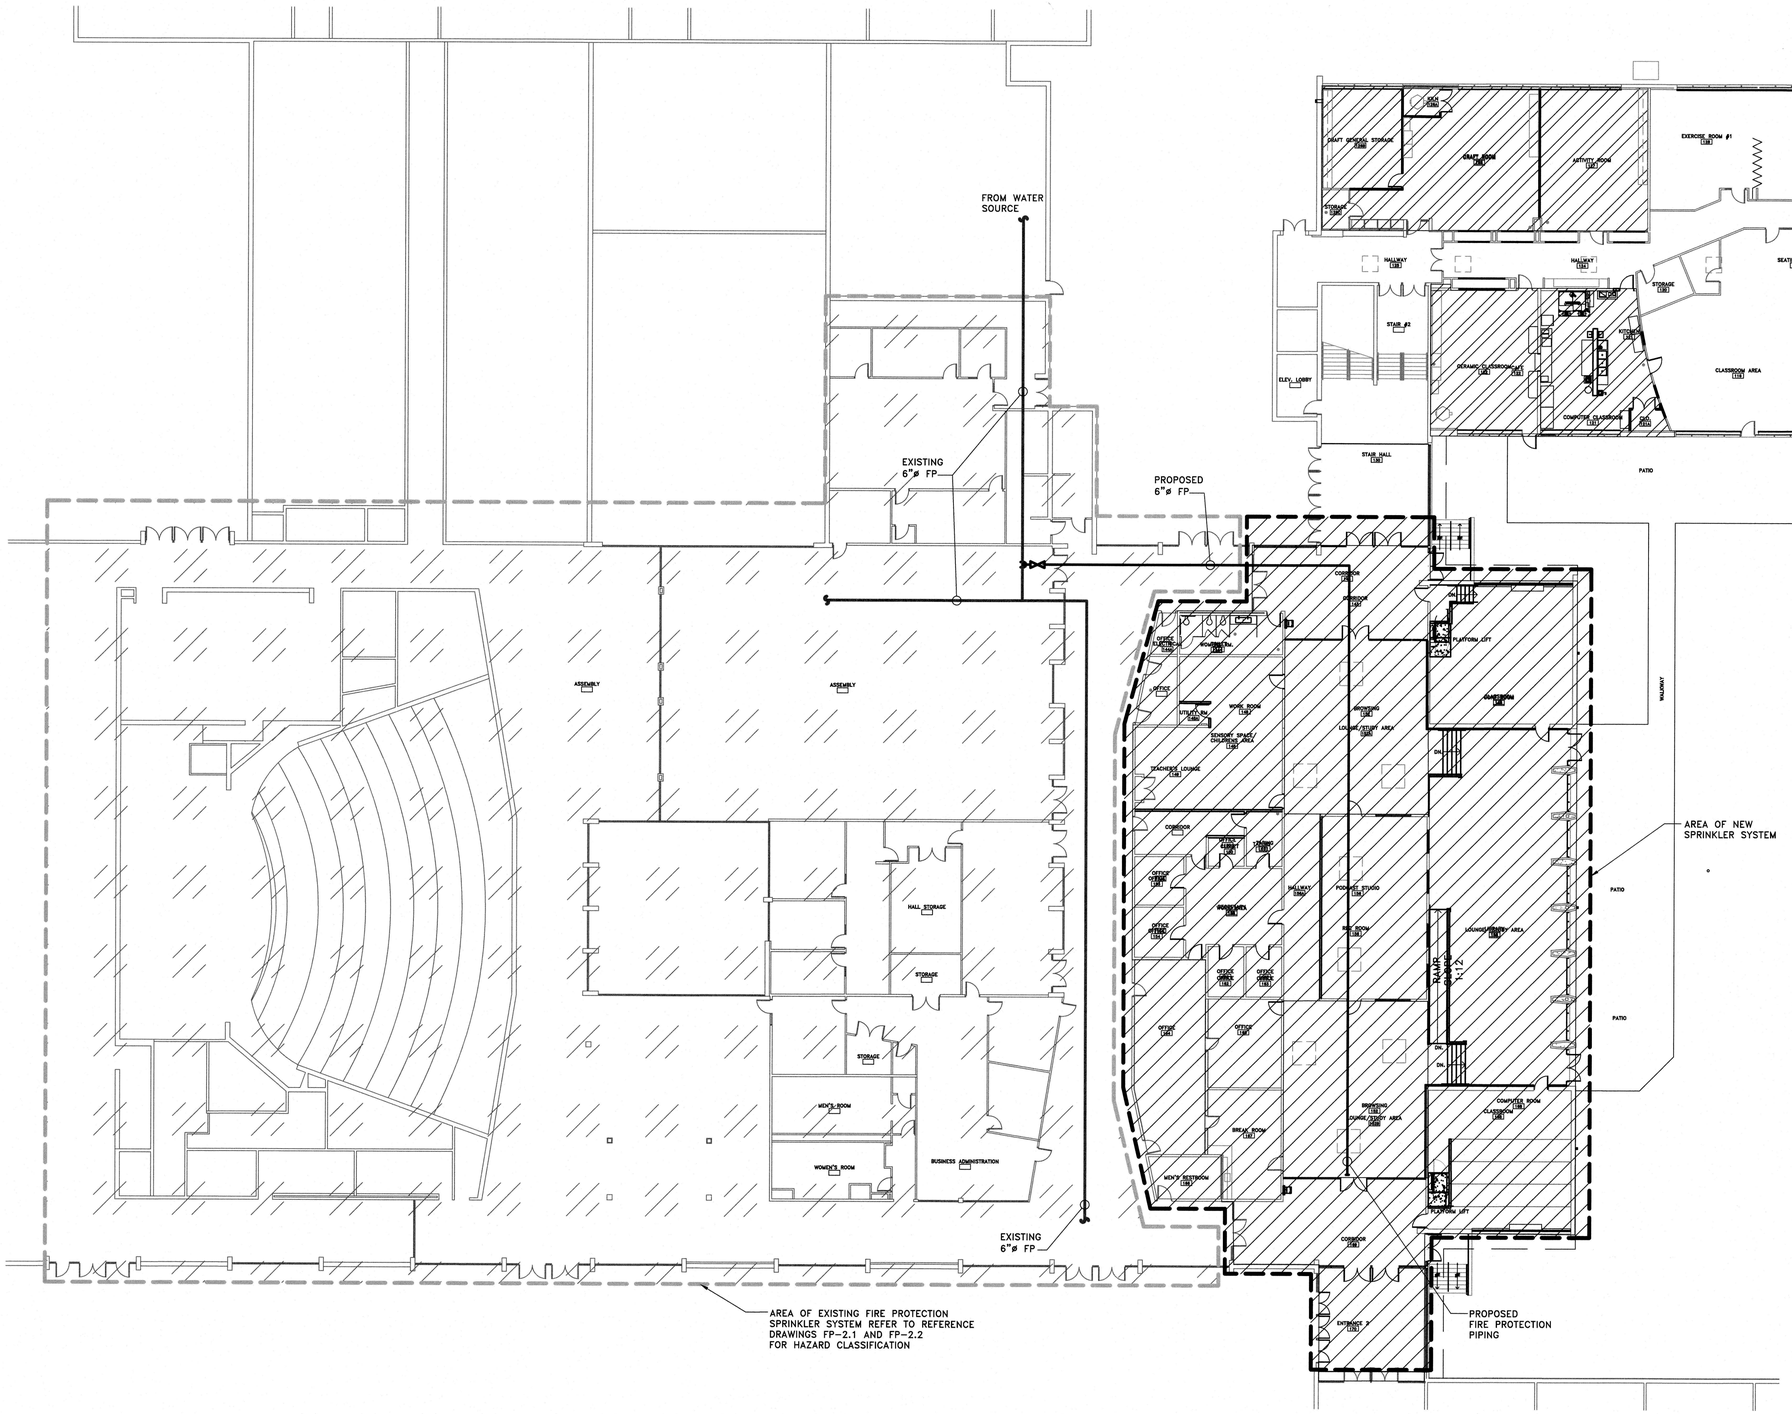

SPRINKLER SYSTEM DESIGN CRITERIA:

1. EXISTING FIRE PROTECTION SPRINKLING SYSTEM TO BE EXPANDED TO COVER AREA OF THE BUILDING AS INDICATED ON THIS DRAWING. THE EXISTING SYSTEM IS AN AUTOMATIC WET PIPE SYSTEM AND EXPANDED AREA ALSO SHALL BE A WET PIPE SYSTEM.
2. THE OCCUPANCY HAZARD CLASSIFICATION FOR THE EXISTING AREA ARE INDICATED ON REFERENCE DRAWINGS FP-2.1 & FP-2.2. THE HAZARD CLASSIFICATION FOR THE NEWLY EXPANDED AREA TO BE LIGHT HAZARD. THE REFERENCE DRAWINGS ARE NOT AS-BUILT DOCUMENTS AND ALL INFORMATION PROVIDED ON REFERENCE DRAWINGS MUST BE FIELD VERIFIED.
3. ALL NEW PIPING TO BE CONCEALED ABOVE LAY-IN CEILING WHERE APPLICABLE, WITH DROP NIPPLES TO RECESSED HEADS IN CEILING AND UPRIGHT HEADS WITHIN CEILING PLENUM.
4. THIS TRADE SECTION SHALL COORDINATE ALL WORK, WITH OTHER CONTRACTORS INVOLVED IN SPACE CONDITIONS BEFORE PROCEEDING WITH INSTALLATION, INCLUDING BUT NOT LIMITED TO HVAC, MECHANICAL, PLUMBING, ELECTRICAL, AND GENERAL CONTRACTORS.
5. THIS TRADE SECTION SHALL INSTALL ALL SPRINKLERS CENTERED IN AT LEAST 1 DIRECTION OF LAY-IN CEILING TILES (UNLESS OTHERWISE DIRECTED BY THE ARCHITECT OR ENGINEER) AND PROVIDE ALL NECESSARY ELBOWS, TEES AND NIPPLES TO ACCOMMODATE THE SAME.
6. THIS TRADE SECTION SHALL REFER TO ARCHITECTURAL DRAWINGS FOR HEIGHTS AND SLOPES OF CEILINGS, SOFFITS AND ROOFS.
7. ENTIRE FIRE PROTECTION SYSTEM INCLUDING EXISTING AREA COVERED BY THE SYSTEM SHALL BE HYDRAULICALLY CALCULATED, DESIGNED BY REGISTERED NJ PROFESSIONAL ENGINEER. SIGNED AND SEALED DESIGN DRAWINGS INCLUDING HYDRAULIC CALCULATIONS AND SUPPORING FLOW TEST SHALL BE SUBMITTED TO LOCAL AUTHORITHY AND UNDERWRITTER FOR APPROVAL PRIOR TO SUBMISSION FOR ARCHITECT/ENGINEER REVIEW.
8. ALL FIRE PROTECTION SYSTEM WORK SHALL COMPLY WITH THE CURRENT APPLICABLE EDITION OF THE INTERNATIONAL BUILDING CODE AS ADOPTED AND IMPLEMENTED BY THE STATE OF NEW JERSEY UNIFORM CONSTRUCTION CODE. ALL WORK SHALL ALSO COMPLY WITH NFPA 13, 14, 20, 24 AND 430.

FIRE PROTECTION LEGEND

- NEW SPRINKLER SYSTEM
- EXISTING TO REMAIN (SMOKE DETECTOR, FIRE ALARM SYSTEM TO REMAIN, ADD ADDITIONAL ITEMS AS NECESSARY FOR CODE COMPLIANCE)
- EXISTING SYSTEM

1 OVERALL FLOOR PLAN

SCALE : 1/16"=1'0"

ISSUED FOR BID-9/25/26

APPROVED 9.23.26
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: RC
CHECKED BY: [illegible]
QUALITY CHECKED BY: [illegible] 9.23.26

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


FIRE PROTECTION
OVERALL FLOOR PLAN

SCALE: AS NOTED

SHEET
FP1

FILE NO.:

Plotted: 9/22/2026 10:00 AM Last saved: 9/21/2026 4:03 PM File Names: M:\Projects\M0410001100\Drawings\GLO-FP1- FloorPlan.dwg

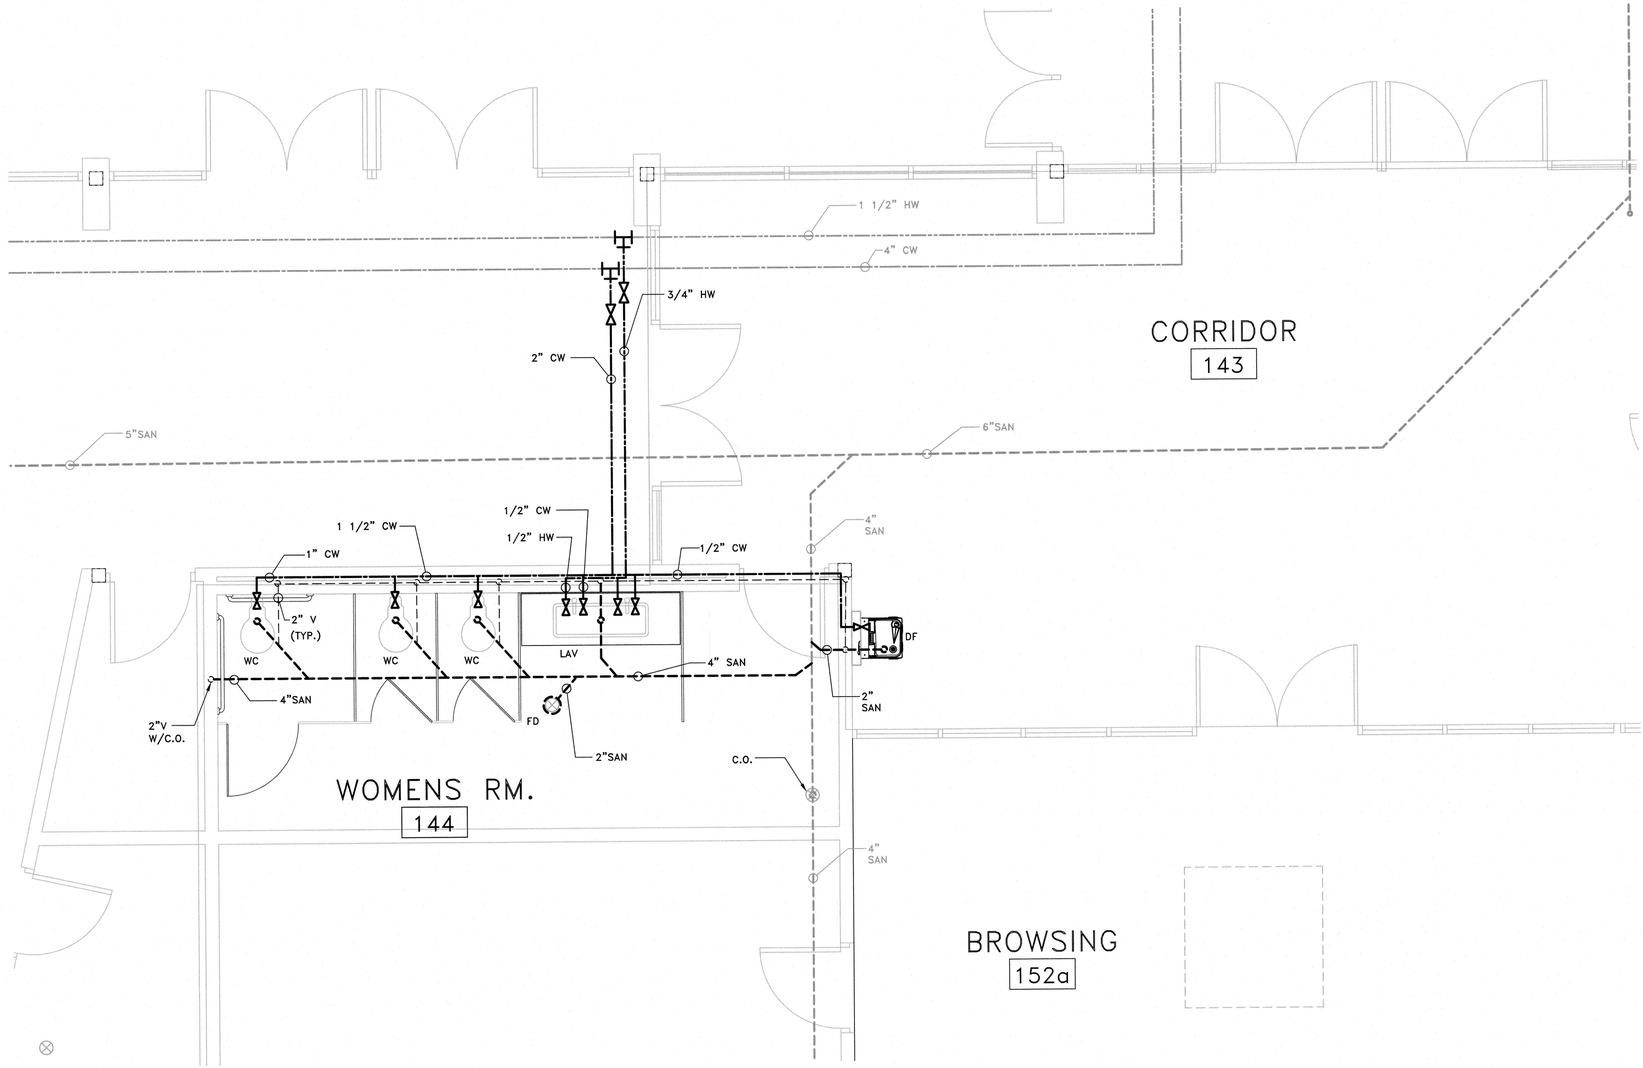

1 FIRST FLOOR WOMEN BATHROOM–PLAN

SCALE: 3/8" = 1'-0"

0 6" 12" 2' 4'

NORTH

NOTES:

1. ALL PLUMBING WORK SHALL BE DONE IN ACCORDANCE WITH THE 2021 NATIONAL STANDARD PLUMBING CODE AND THE CURRENT NEW JERSEY UNIFORM CONSTRUCTION CODE. NO WORK SHALL BE DONE IN VIOLATION OF THESE CODES. ANY WORK SHOWN ON THESE DRAWINGS THAT ARE IN VIOLATION OF SUCH CODES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER AND SHALL BE RESOLVED PRIOR TO INSTALLATION.
2. ALL UNDER GROUND AND UNDER BUILDING SANITARY PIPING SHALL HAVE MINIMUM COVER AS FOLLOW:
   - MINIMUM EARTH COVER FOR PIPES UNDER THE BUILDING SHALL BE 12 INCHES.
   - MINIMUM EARTH COVER FOR PIPES OUTSIDE THE BUILDING SHALL BE 3 FEET.
3. ALL SANITARY PIPING TO BE SLOPED A MINIMUM 1/4 INCH PER FOOT.
4. ALL FLOOR DRAINS TO BE DEEP SEAL TYPE, WITH SEAL DEPTH OF MINIMUM 4 INCHES.
5. ALL PIPING LOCATIONS TO BE COORDINATED IN FIELD WITH LOCATION OF THE EQUIPMENT TO BE DRAINED.
6. CONTRACTOR TO COMBINE INDIVIDUAL VENT PIPE INTO GROUPS PRIOR TO EXTENSION ABOVE THE ROOF STOCK. COMBINED VENT PIPE SHALL BE SIZED IN ACCORDANCE WITH PLUMBING CODE.

LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- PROPOSED UNDERGROUND SANITARY (SAN)
- PROPOSED SANITARY VENTS (V)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)
- PROPOSED POTABLE HOT WATER (HW)
- PROPOSED POTABLE COLD WATER (CW)

HC: HAND SINK
3C-SINK: THREE COMPARTMENT SINK
F.S.: FLOOR SINK
G.T.: GREASE TRAP
C.O.: CLEANOUT

ISSUED FOR BID-9/25/26

APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RLC
DRAWN BY: RKR
CHECKED BY: RLC
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


FIRST FLOOR PLAN
PLUMBING NEW WORK

SCALE: AS NOTED

SHEET
P1

FILE NO.:

Plotted: 9/23/2026 11:06 AM Last saved: 9/23/2026 11:05 AM File Name: M:\Projects\M0410001000\Drawings\GLO-P1 P2 P3.dwg

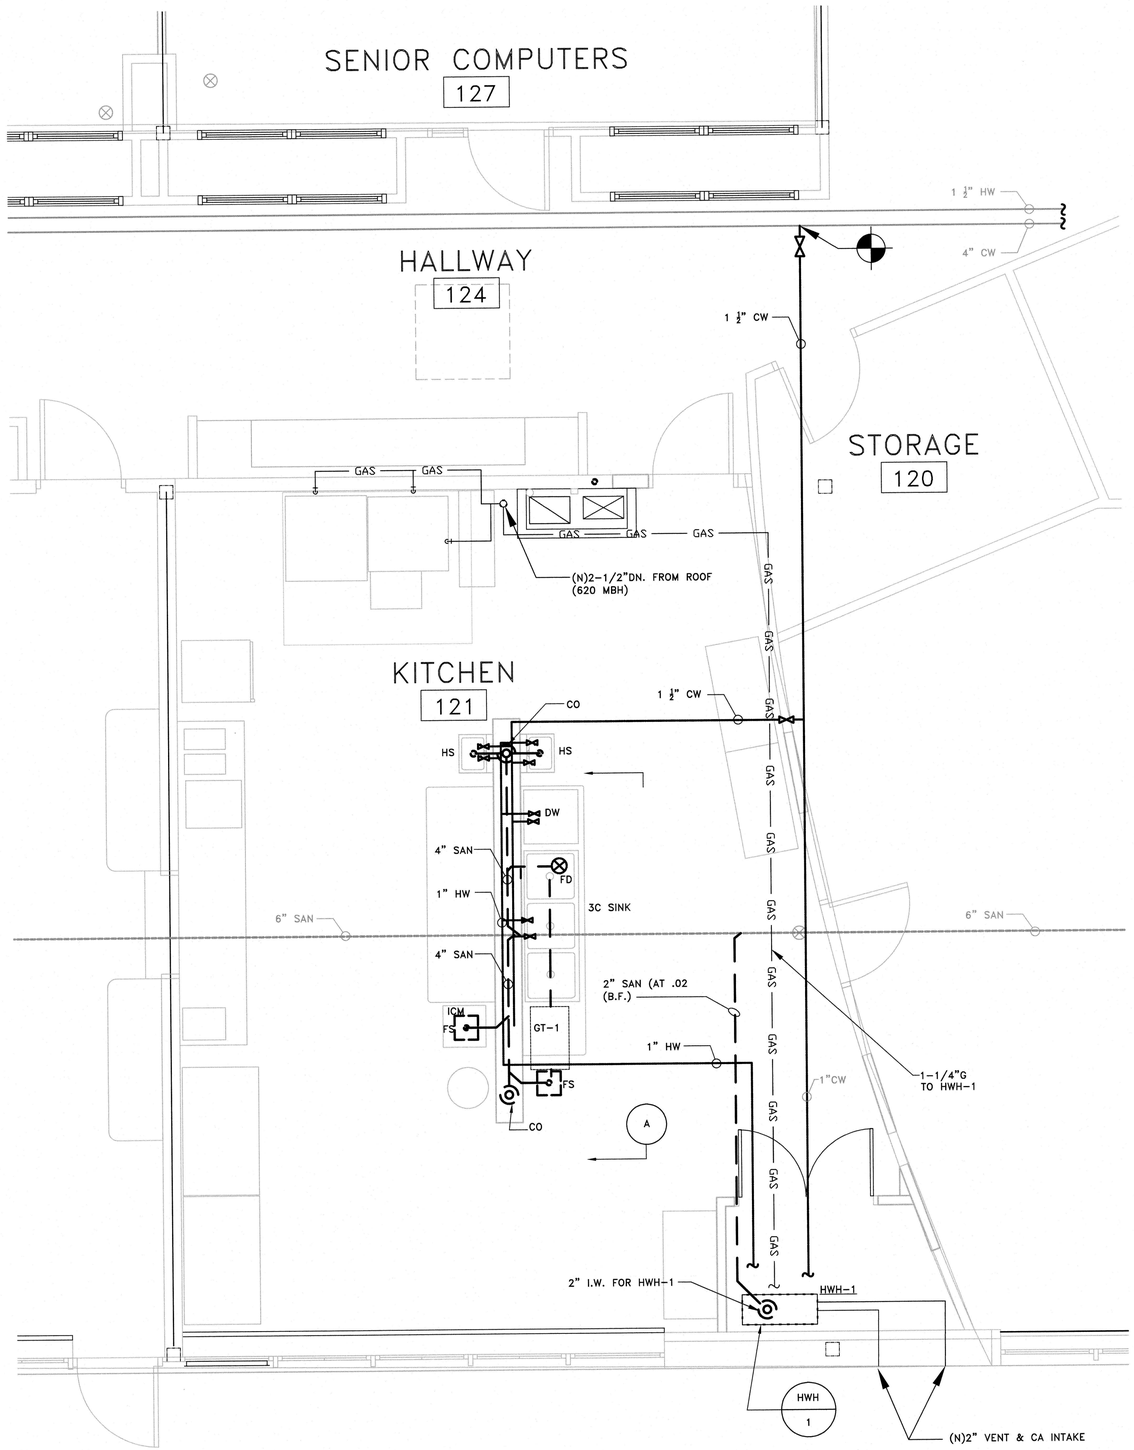

1 FIRST FLOOR KITCHEN PLAN – PLUMBING NEW WORK

SCALE: 3/8" = 1'-0"

0 6" 12" 2' 4'

NORTH


LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- PROPOSED UNDERGROUND SANITARY (SAN)
- PROPOSED SANITARY VENTS (V)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)
- PROPOSED POTABLE HOT WATER (HW)
- PROPOSED POTABLE COLD WATER (CW)
- GAS GAS GAS GAS PROPOSED GAS (G)

H.C.: HAND SINK
3C–SINK: THREE COMPARTMENT SINK
F.S.: FLOOR SINK
G.T.: GREASE TRAP
C.O.: CLEANOUT
F.D.: FLOOR DRAIN
D.W.: DISHWASHER

NOTES:

1. ALL PLUMBING WORK SHALL BE DONE IN ACCORDANCE WITH THE 2021 NATIONAL STANDARD PLUMBING CODE AND THE CURRENT NEW JERSEY UNIFORM CONSTRUCTION CODE. NO WORK SHALL BE DONE IN VIOLATION OF THESE CODES. ANY WORK SHOWN ON THESE DRAWINGS THAT ARE IN VIOLATION OF SUCH CODES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER AND SHALL BE RESOLVED PRIOR TO INSTALLATION.
2. ALL UNDER GROUND AND UNDER BUILDING SANITARY PIPING SHALL HAVE MINIMUM COVER AS FOLLOW:
   – MINIMUM EARTH COVER FOR PIPES UNDER THE BUILDING SHALL BE 12 INCHES.
   – MINIMUM EARTH COVER FOR PIPES OUTSIDE THE BUILDING SHALL BE 3 FEET.
3. ALL SANITARY PIPING TO BE SLOPED A MINIMUM 1/4 INCH PER FOOT.
4. ALL FLOOR DRAINS TO BE DEEP SEAL TYPE, WITH SEAL DEPTH OF MINIMUM 4 INCHES.
5. ALL PIPING LOCATIONS TO BE COORDINATED IN FIELD WITH LOCATION OF THE EQUIPMENT TO BE DRAINED.
6. CONTRACTOR TO COMBINE INDIVIDUAL VENT PIPE INTO GROUPS PRIOR TO EXTENSION ABOVE THE ROOF STOCK. COMBINED VENT PIPE SHALL BE SIZED IN ACCORDANCE WITH PLUMBING CODE.
7. REFER TO DRAWING P4 FOR NATURAL GAS PIPING RISER DIAGRAM.
8. FOR KITCHEN EQUIPMENT LIST REFER TO ARCHITECTURAL DRAWING.
9. EXACT NUMBER, SIZE, AND LOCATIONS OF THE PLUMBING CONNECTIONS TO THE EQUIPMENT TO BE DETERMINE, AS RECOMMENDED BY THE MANUFACTURE DURING SHOP DRAWING REVIEW. CONTRACTOR TO PROVIDE AND INSTALL ALL PARTS AS REQUIRED FOR INSTALLATION AND OPERATION OF THE EQUIPMENT WITHOUT ADDITIONAL COST TO THE OWNER.

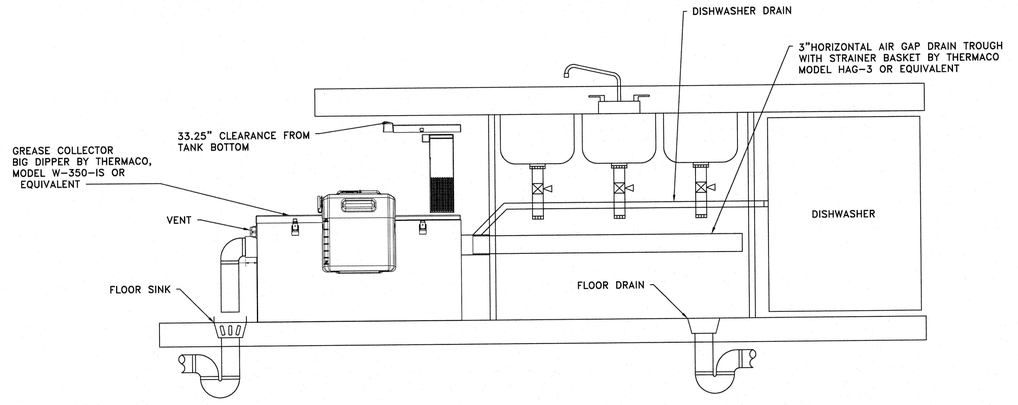

SECTION A

SCALE: NOT TO SCALE

HOT WATER HEATER SCHEDULE (HWH #)

EQUIP. TAG	LOCATION	STORAGE CAPACITY (GAL.)	TYPE	INPUT (BTUh)	RECOVERY RATE	VENT SIZE	ELECTRICAL V/ø/Hz.	MANUFACTURER MODEL No.	ACCESSORIES REQUIRED
HWH–1	KITCHEN CLOSET	TANKLESS	NATURAL GAS W/ ELEC. IGNITION	199,000	5 GPM FLOW AT 75°F RISE	3"	120/1/60	BRADFORD WHITE TG–199 I–N RTG–199 HE–N	SEE NOTES AND SPECIFICATIONS

PROVIDE ALL ACCESSORIES AS REQUIRED FOR INSTALLATION AND OPERATION OF THE HEATERS.

ISSUED FOR BID-9/25/26

APPROVED 9.23.26
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

REVISIONS	DATE	BY

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RKR
DRAWN BY: RKR
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


FIRST FLOOR PLAN
PLUMBING NEW WORK

SCALE: AS NOTED

SHEET
P2

FILE NO.:

Plotted: 9/23/2026 11:13 AM Last saved: 9/23/2026 11:13 AM File Name: M:\Projects\M0410001000\Drawings\CLG-P1 P2 P3.dwg

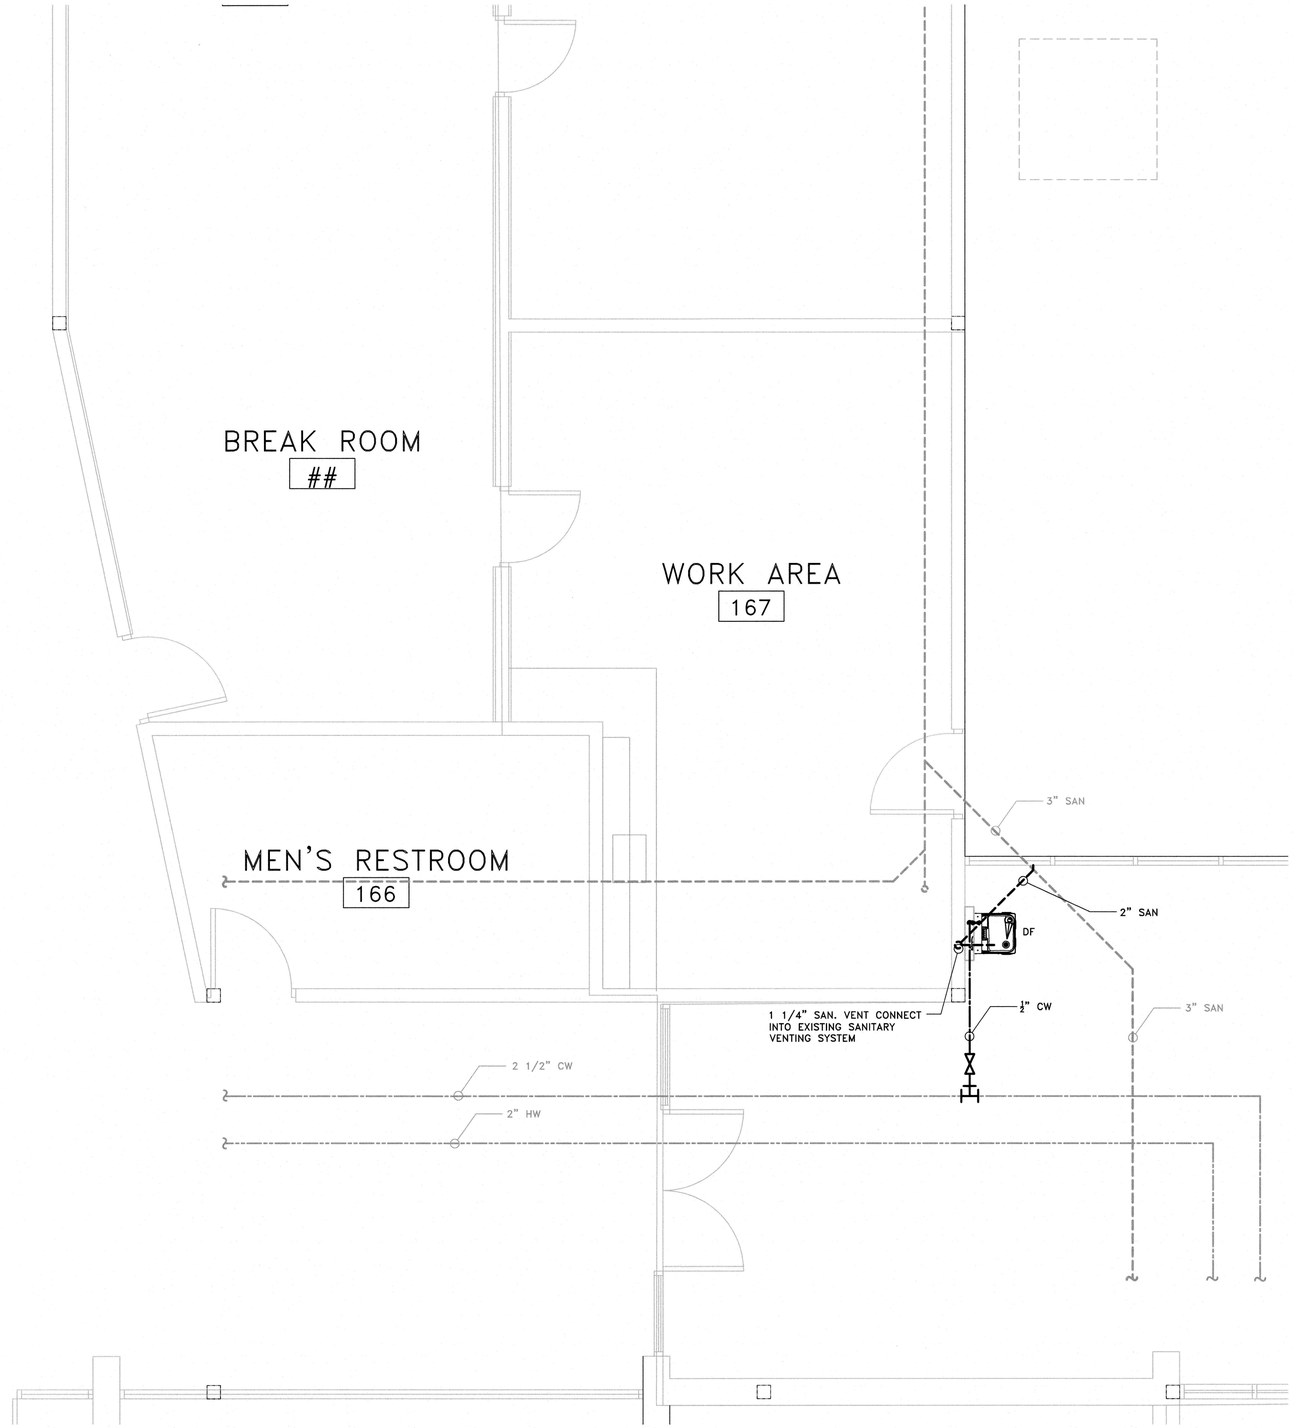

1 FIRST FLOOR DRINKING FOUNTAIN PLAN – PLUMBING NEW WORK

SCALE: 3/8" = 1'-0"

0 6" 12" 2' 4'

NORTH

LEGEND:

- EXISTING UNDERGROUND SANITARY (SAN)
- PROPOSED UNDERGROUND SANITARY (SAN)
- PROPOSED SANITARY VENTS (V)
- EXISTING POTABLE COLD WATER (CW)
- EXISTING POTABLE HOT WATER (HW)
- PROPOSED POTABLE HOT WATER (HW)
- PROPOSED POTABLE COLD WATER (CW)
- GAS GAS GAS GAS PROPOSED GAS (G)

H.C.: HAND SINK
3C-SINK: THREE COMPARTMENT SINK
F.S.: FLOOR SINK
G.T.: GREASE TRAP
C.O.: CLEANOUT
F.D.: FLOOR DRAIN
D.W.: DISHWASHER

NOTES:

1. ALL PLUMBING WORK SHALL BE DONE IN ACCORDANCE WITH THE 2021 NATIONAL STANDARD PLUMBING CODE AND THE CURRENT NEW JERSEY UNIFORM CONSTRUCTION CODE. NO WORK SHALL BE DONE IN VIOLATION OF THESE CODES. ANY WORK SHOWN ON THESE DRAWINGS THAT ARE IN VIOLATION OF SUCH CODES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER AND SHALL BE RESOLVED PRIOR TO INSTALLATION.
2. ALL UNDER GROUND AND UNDER BUILDING SANITARY PIPING SHALL HAVE MINIMUM COVER AS FOLLOW:
   – MINIMUM EARTH COVER FOR PIPES UNDER THE BUILDING SHALL BE 12 INCHES.
   – MINIMUM EARTH COVER FOR PIPES OUTSIDE THE BUILDING SHALL BE 3 FEET.
3. ALL SANITARY PIPING TO BE SLOPED A MINIMUM 1/4 INCH PER FOOT.
4. ALL FLOOR DRAINS TO BE DEEP SEAL TYPE, WITH SEAL DEPTH OF MINIMUM 4 INCHES.
5. ALL PIPING LOCATIONS TO BE COORDINATED IN FIELD WITH LOCATION OF THE EQUIPMENT TO BE DRAINED.
6. CONTRACTOR TO COMBINE INDIVIDUAL VENT PIPE INTO GROUPS PRIOR TO EXTENSION ABOVE THE ROOF STOCK. COMBINED VENT PIPE SHALL BE SIZED IN ACCORDANCE WITH PLUMBING CODE.

ISSUED FOR BID-9/25/26

APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012
9.23.26

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: RC
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER


FIRST FLOOR PLAN
PLUMBING NEW WORK

SCALE: AS NOTED

SHEET
P3

FILE NO.:

Plotted: 9/23/2026 11:17 AM Last saved: 9/23/2026 11:13 AM File Name: M:\Projects\M0410001000\Drawings\GLG-P1 P2 P3.dwg

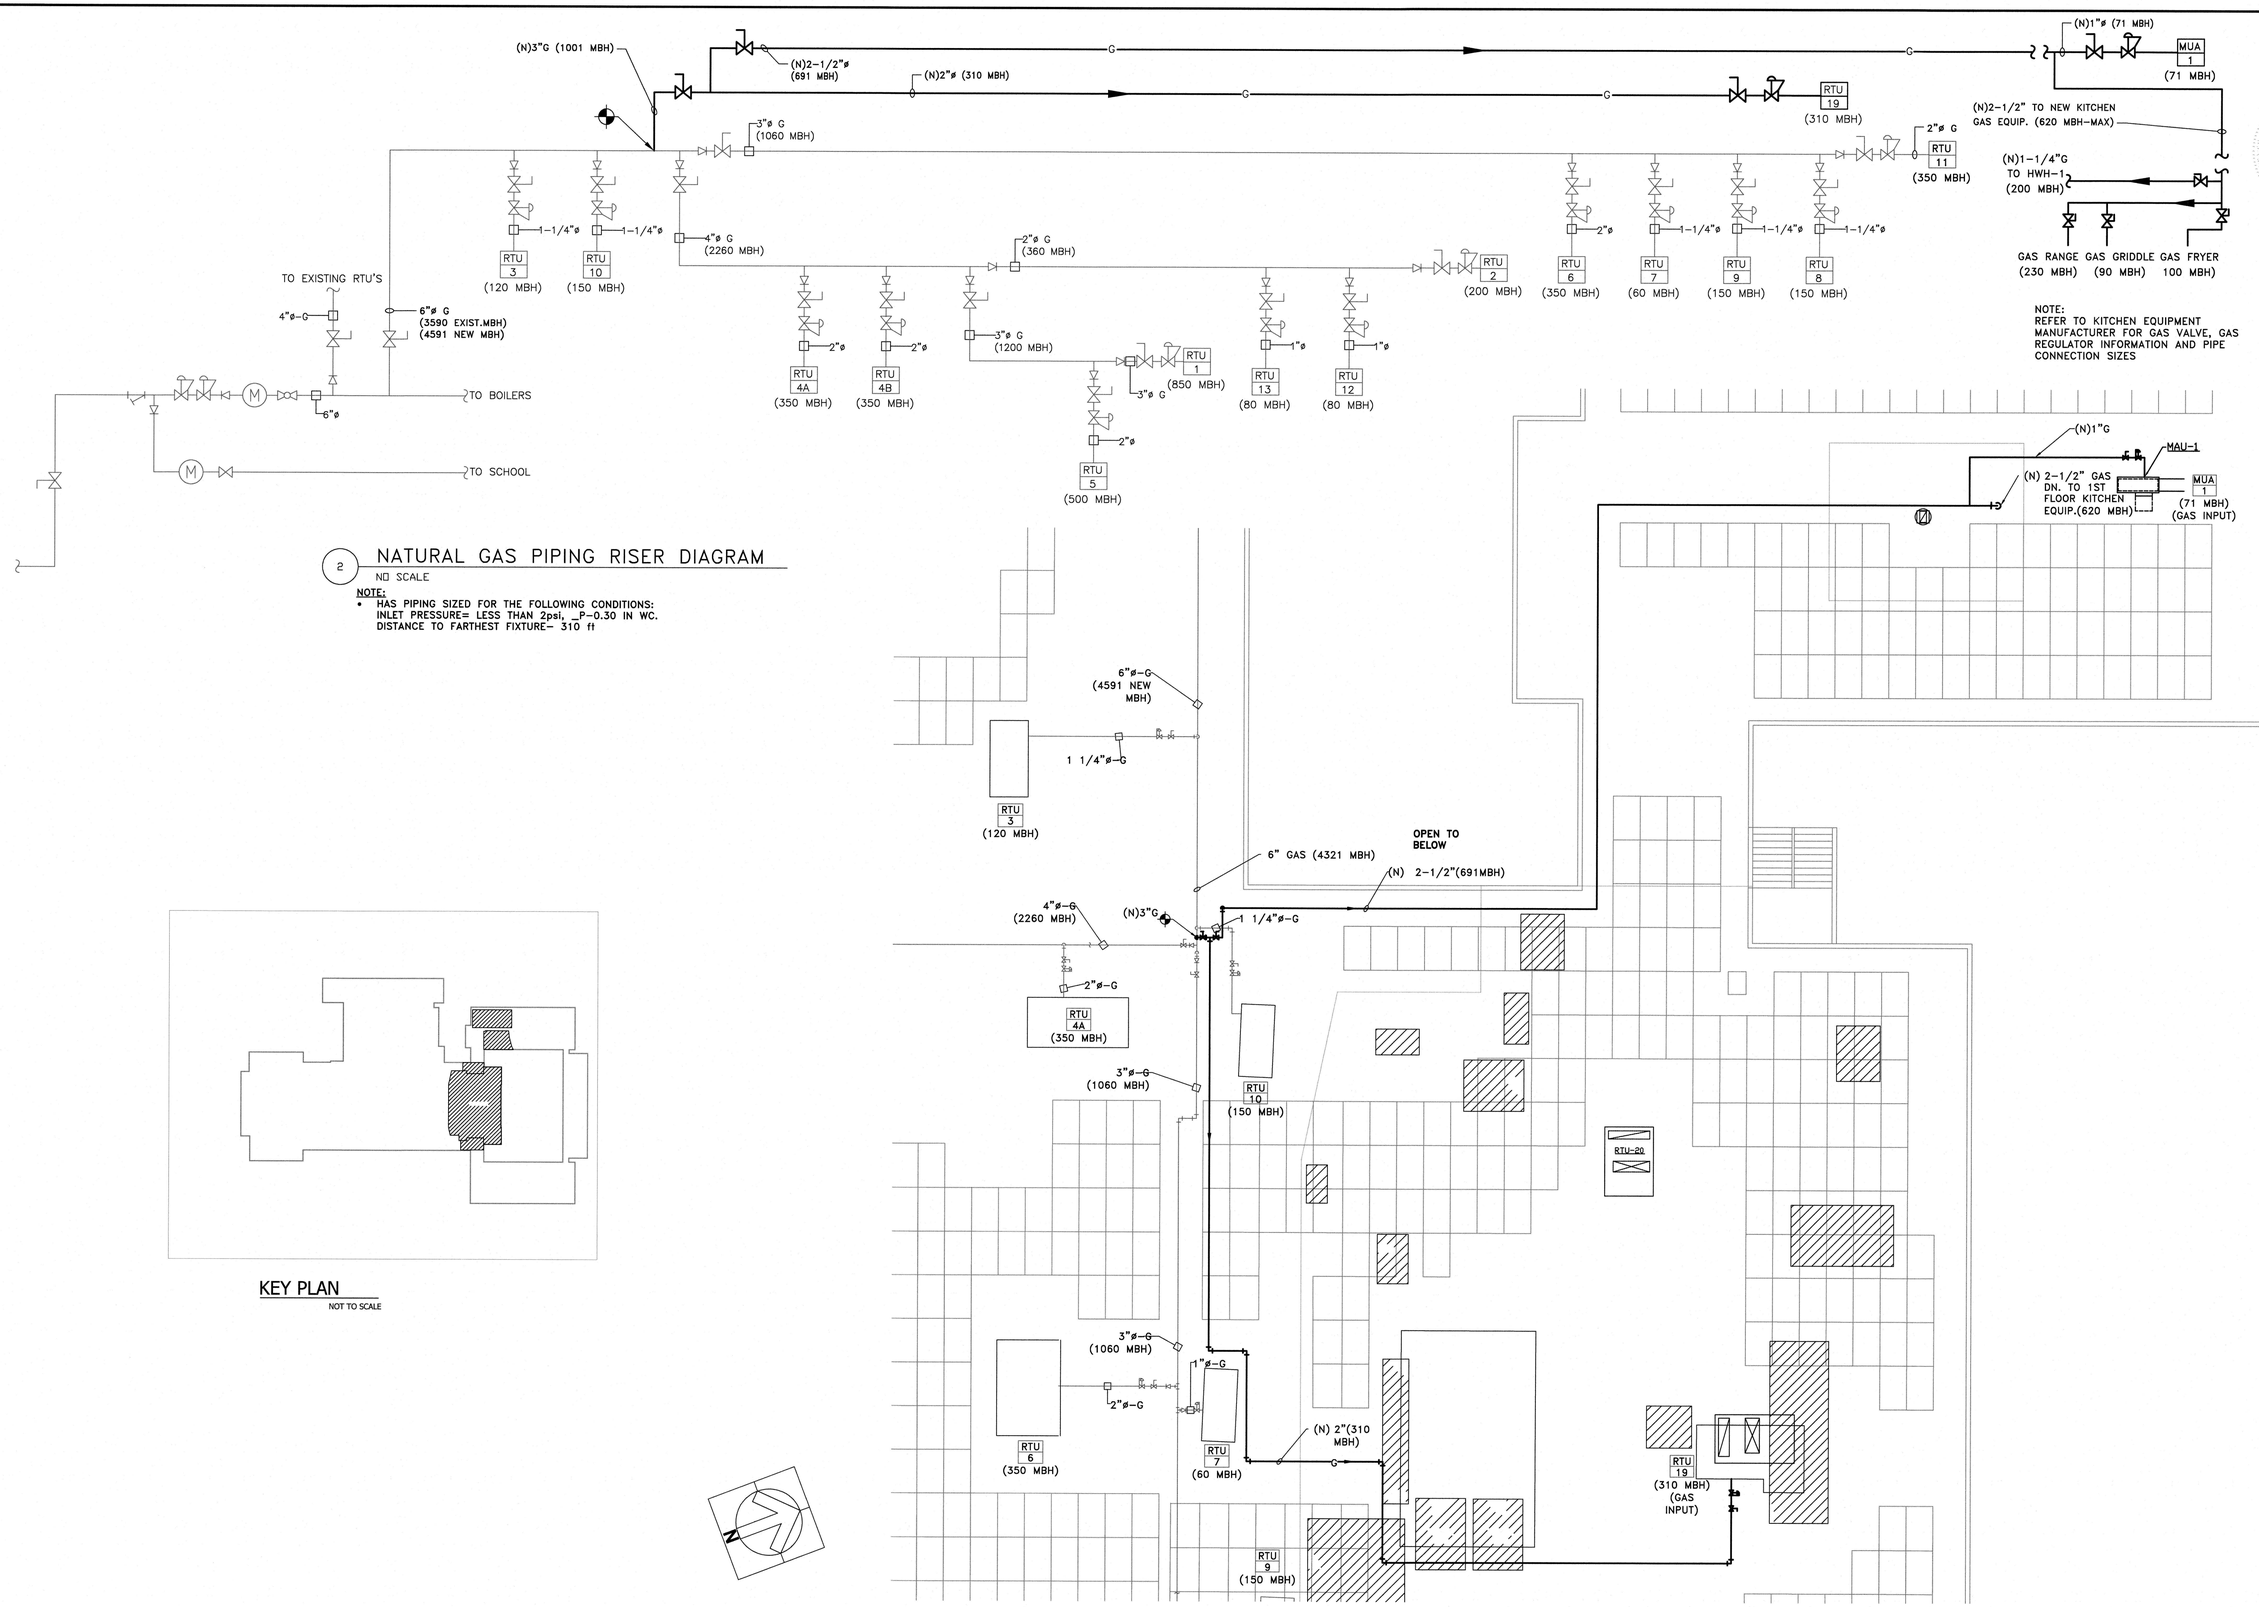

2 NATURAL GAS PIPING RISER DIAGRAM

NO SCALE

NOTE:

- HAS PIPING SIZED FOR THE FOLLOWING CONDITIONS: INLET PRESSURE= LESS THAN 2psi, _P=0.50 IN WC. DISTANCE TO FARTHEST FIXTURE= 310 ft

KEY PLAN

NOT TO SCALE

1 PART. ROOF PLAN -PLUMBING NEW WORK

SCALE : 3/32"=1'0"

ISSUED FOR BID-9/25/26

APPROVED
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012
9.23.26

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group

WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: RKR
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026


KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER
PARTIAL ROOF PLAN AND
PARTIAL GAS RISER DIAGRAM
PLUMBING NEW WORK

SCALE: AS NOTED


SHEET
P4

FILE NO.:

Plotted: 9/22/2026 3:43 PM Last saved: 9/22/2026 3:35 PM File Name: M:\Projects\M0410001\000\Drawings\CLO-P4.dwg

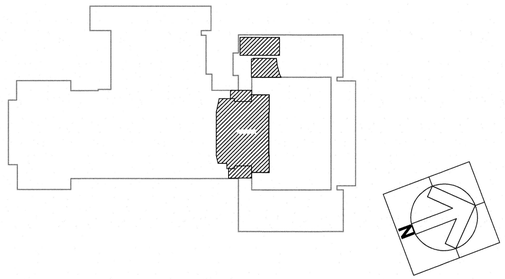

KEY PLAN
NOT TO SCALE

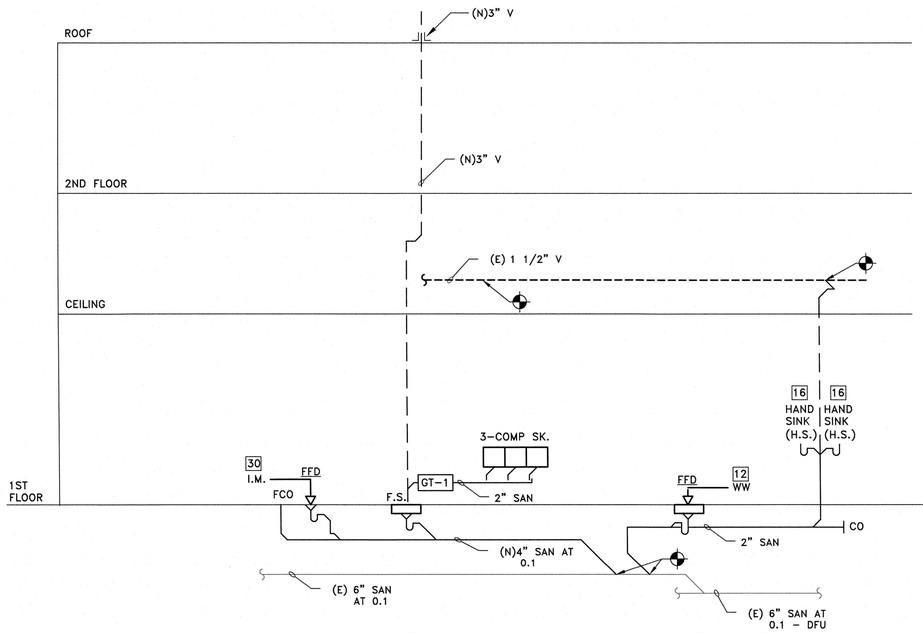

1 PART. SANITARY RISER DIAGRAM
NO SCALE

PLUMBING

- COLD WATER PIPING
- HOT WATER PIPING (120°F)
- HOT WATER RETURN PIPING
- SANITARY PIPING ABOVE FLOOR
- SANITARY PIPING BELOW FLOOR
- VENT PIPING
- NATURAL GAS PIPING
- UNION
- WATER PIPING RISER
- WATER PIPING DROP
- FLOOR DRAIN-SQUARE OR ROUND

FOOD SERVICE PLUMBING SCHEDULE

ITEM NUMBER	QUANTITY	DESCRIPTION	HW SIZE	HW AFF	CW SIZE	CW AFF	WASTE SIZE	TRAP SIZE	IW SIZE	PLUMBING REMARKS
12	1	UNDERCOUNTER WEAR WASHER	–	12"	–	12"	–	–	3/4"	HOBART US FOOD SERVICE LXEH-1
14	1	3 COMPARTMENT SINK	1/2"	38"	1/2"	38"			(3) 1-1/2"	ADVANCE TABCO-94-23-60-24L 3-COMPARTMENT SINK. PROVIDE WITH ADVANCED TABCO K-11 SWING SPOUT
–	1	PRE-PRINSE FAUCET	1/2"	38"	1/2"	38"				PROVIDED WITH 3-COMPARTMENT SINK.
16	2	WALL MOUNTED HAND SINK	1/2"	T.B.D	1/2"	T.B.D.	1-1/2"	1-1/2"		ADVANCE TABCO-7-PS-76 WITH GOOSENECK FAUCET, KEYED VALVE STOPS, STRAINER AND P-TRAP.
30	1	ICE MAKER							3/4"	WITH WATER FILTER (SEE DWG A9)
–	1	WATER FILTER			1/2"	–				WITH WATER FILTER (SEE DWG A9)

ISSUED FOR BID-9/25/26

APPROVED 9.23.26
William R. Long
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE NO. 33012

APPROVED
Anita S. Aradhya
REGISTERED ARCHITECT
NEW JERSEY LICENSE NO. 18769

BY	DATE	REVISIONS

Tri-State Architects, P.C. / Alaimo Group
WILLIAM R. LONG, P.E. LIC. 33012
ANITA S. ARADHYA, R.A. LIC. 18769
200 HIGH STREET MOUNT HOLLY, N.J.

DATE: AUG. 2026
DESIGNED BY: RC
DRAWN BY: RKR
CHECKED BY:
DEPT. HEAD:

CLIENT: WILLINGBORO TOWNSHIP
PROJECT LOCATION: WILLINGBORO TWP. BURLINGTON COUNTY NEW JERSEY
PROJECT NO.: M-0410-0011-000
CONTRACT NO.: BID#8-2026

KENNEDY CENTER
RENOVATION TO THE SENIOR CENTER

PLUMBING DETAILS
SCHEDULES AND DIAGRAMS

SCALE: AS NOTED

SHEET
P5

FILE NO.:

Plotted: 9/22/2026 9:07 AM Last saved: 9/21/2026 4:03 PM File Name: M:\Projects\M0410001\0001\Drawings\GLG-P5.dwg